




## Typical Overhead Service Diagram for Temporary Pole

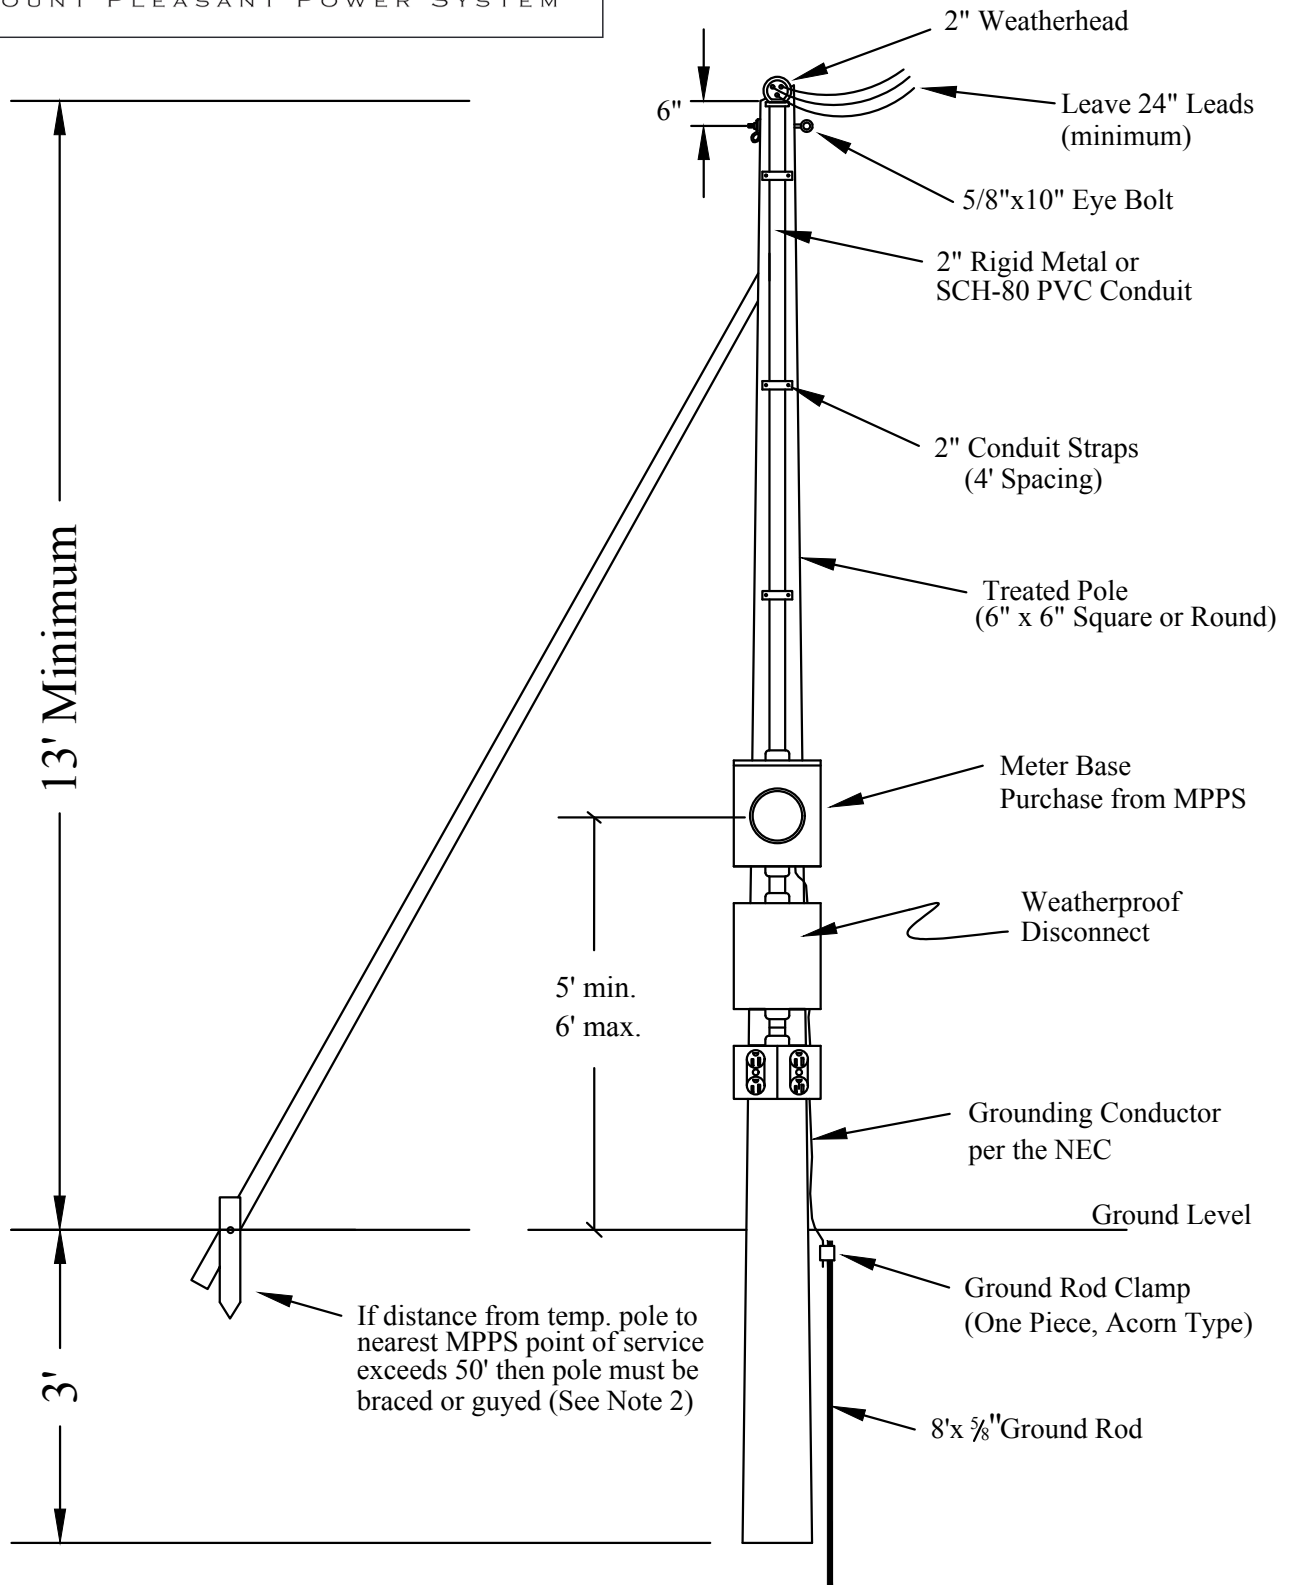

### NOTES:

1. Temporary pole locations must be approved by MPPS prior to installation.
2. MPPS recommends that temporary poles be within 50' of nearest point of service but can be further with approval from MPPS
3. Ground rod, foundation, & metal facilities shall be grounded according to the NEC.