




## Typical 200 AMP Overhead Service Diagram Mobile Home Pole

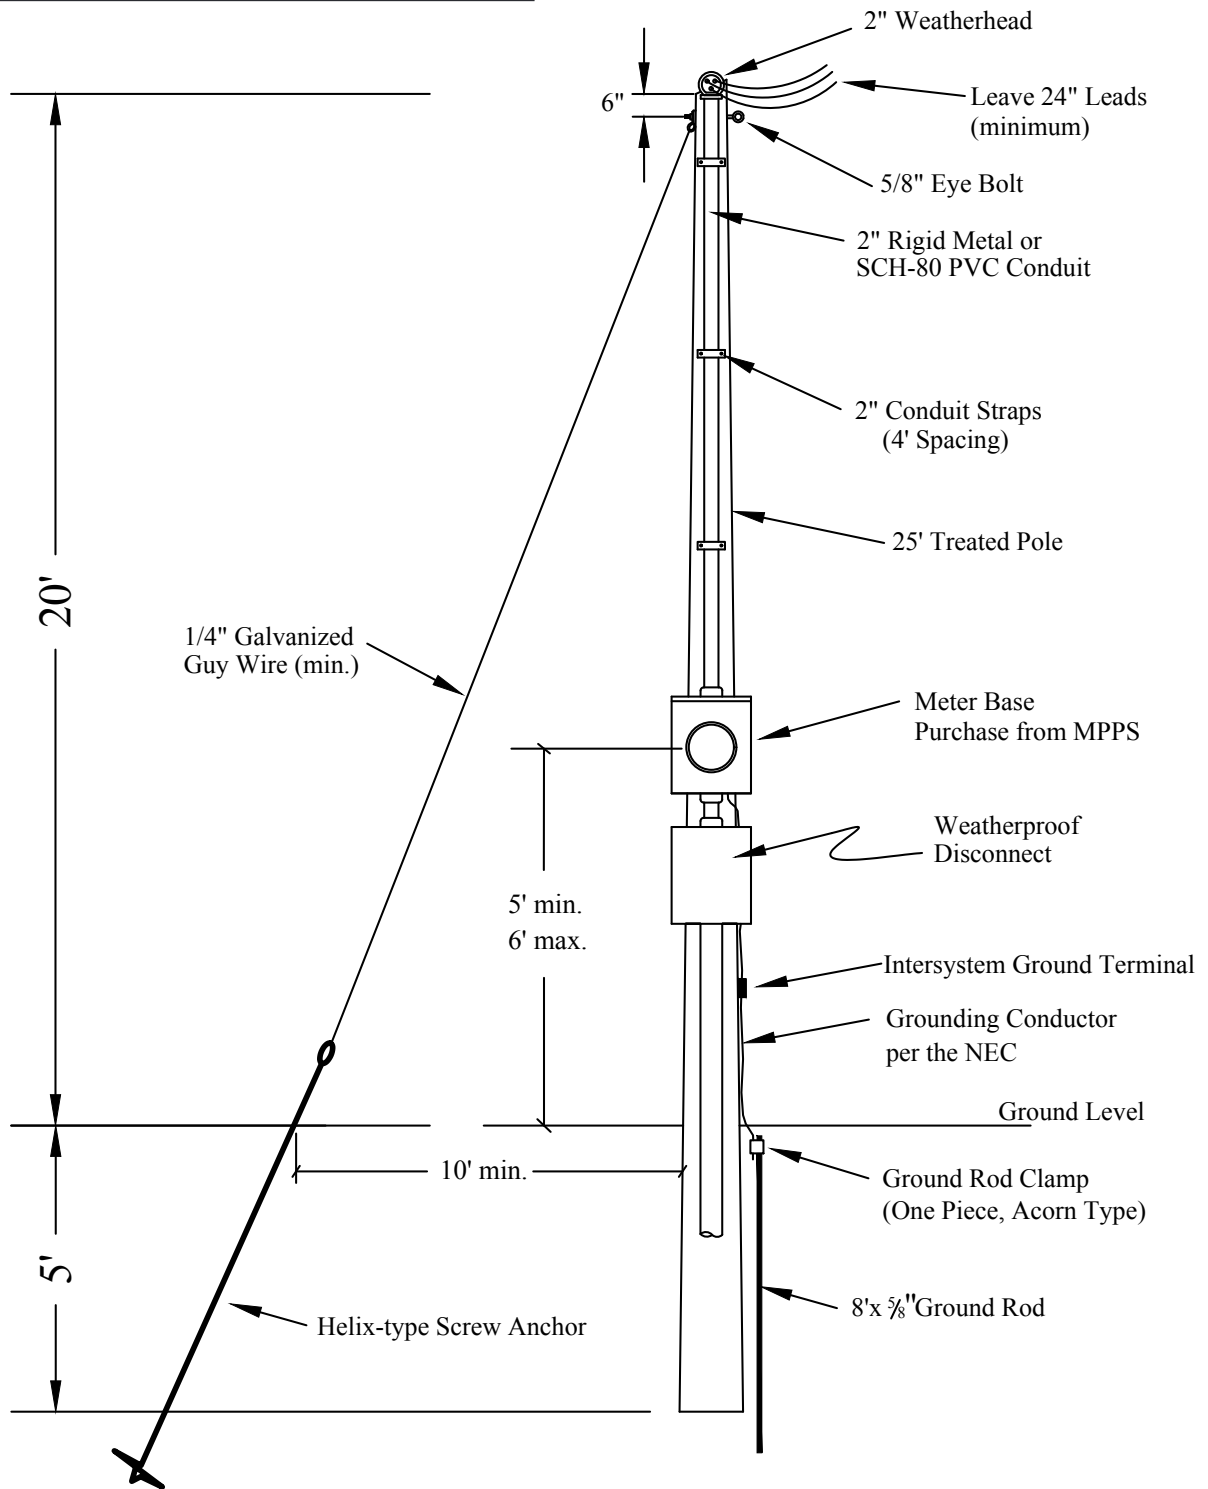

### NOTES:

1. Meter locations must be approved by MPPPS prior to installation.
3. All mobile home services must be located within 30 feet of mobile home.
3. All conductors are to be sized and installed according to the NEC.
4. Ground rod, foundation, & metal facilities shall be grounded according to the NEC.